



750 GALLON RESIDENTIAL SEPTIC TANKS

ITEM #A-1001
WEIGHT - 7,400 LBS

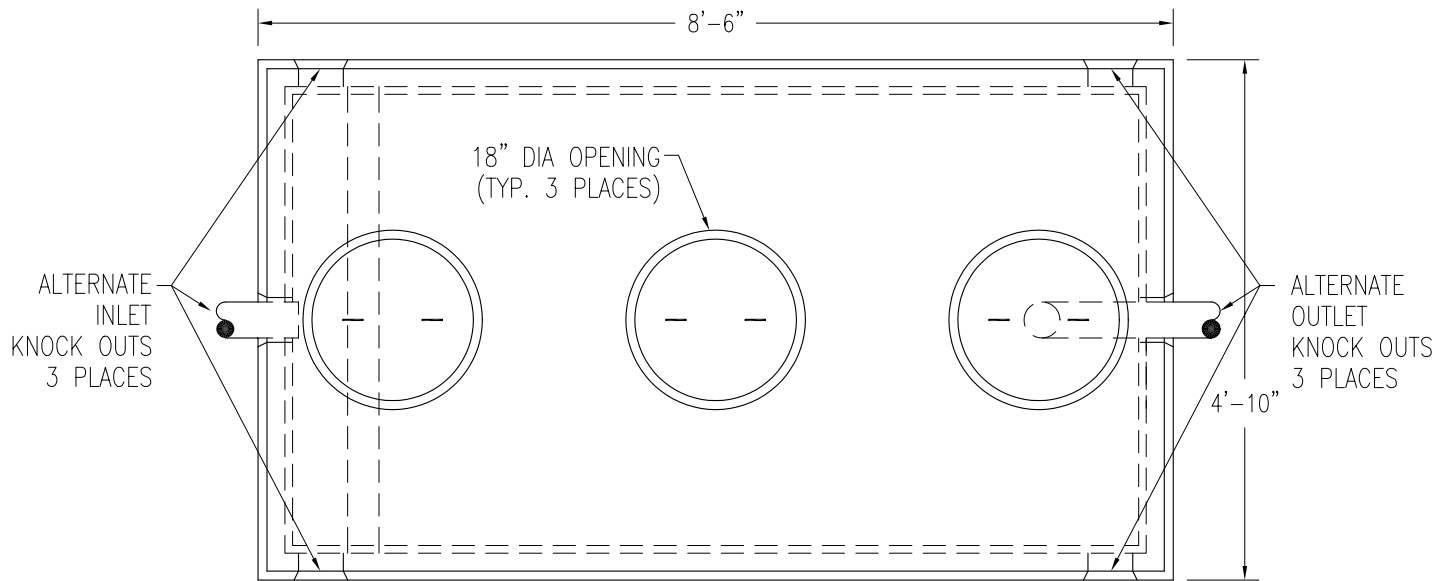

TOP VIEW

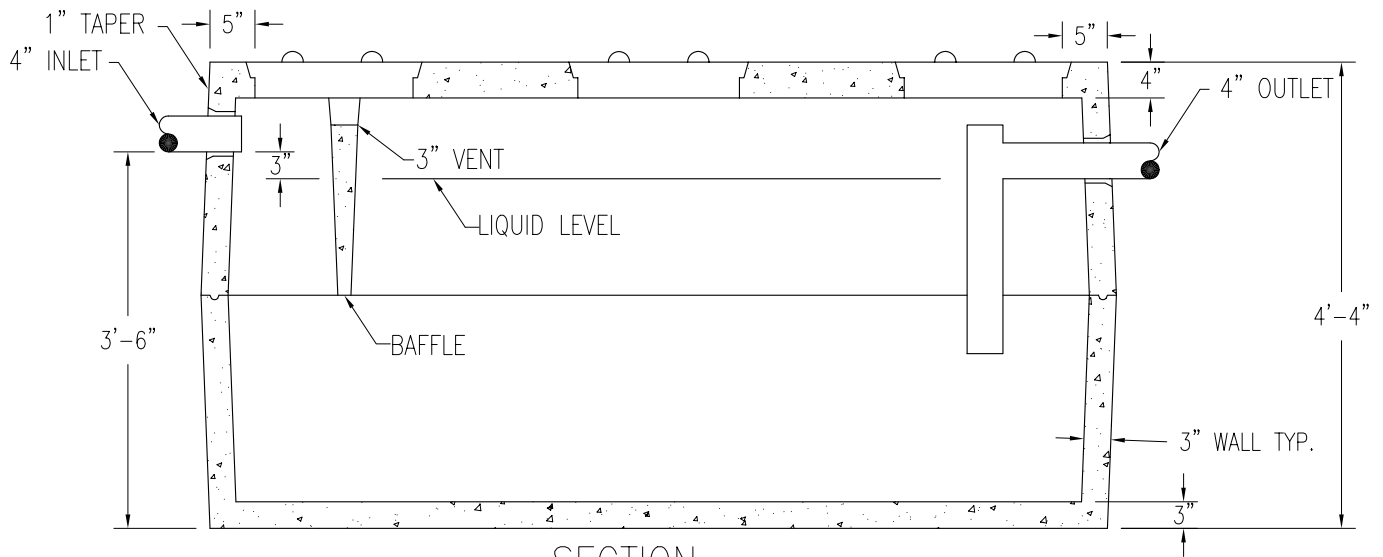

SECTION

DESIGN NOTES:

- | | |
|--|---|
| <ul style="list-style-type: none"> 1 - CONCRETE 4000 PSI AT 28 DAYS. 2 - INLET BAFFLE IS PRECAST AS ONE UNIT WITH THE TOP SECTION OF THE SEPTIC TANK. 3 - TANKS REINFORCED WITH 6X6X10 G.A. WIRE. 4 - KEYED JOINTS SEALED WITH ASPHALT CEMENT OF EQUIVALENT. | <ul style="list-style-type: none"> 5 - EXCAVATION MUST BE AT LEAST 12" WIDER AND LONGER THAN THE TANK. 6 - HEAVY DUTY SEPTIC TANKS FOR DRIVEWAYS, TOPS REINFORCED WITH 1/2" REBAR ON 6" CENTERS EACH WAY. |
|--|---|